

**Glendo Powerplant
Seasonal**

Ancillary Services

**Glendo
Ancillary Services**

Spinning Reserve	No
Non-Spinning Reserve	No
Replacement Reserve	Yes
Regulation/Load Following	No
Black Start	No
Voltage Support	Yes

Generators



Glendo Generators

Existing Number and Capacity

Unit #	Original Capacity (kW)	Capacity Increased (kW)	Present Capacity (kW)
1	12,000	7,000	19,000
2	12,000	7,000	19,000
2 Units	24,000	14,000	38,000


**Glendo Powerplant
Seasonal**

Generation

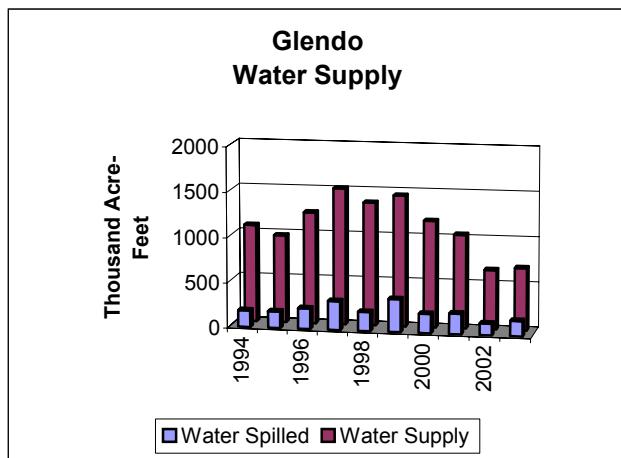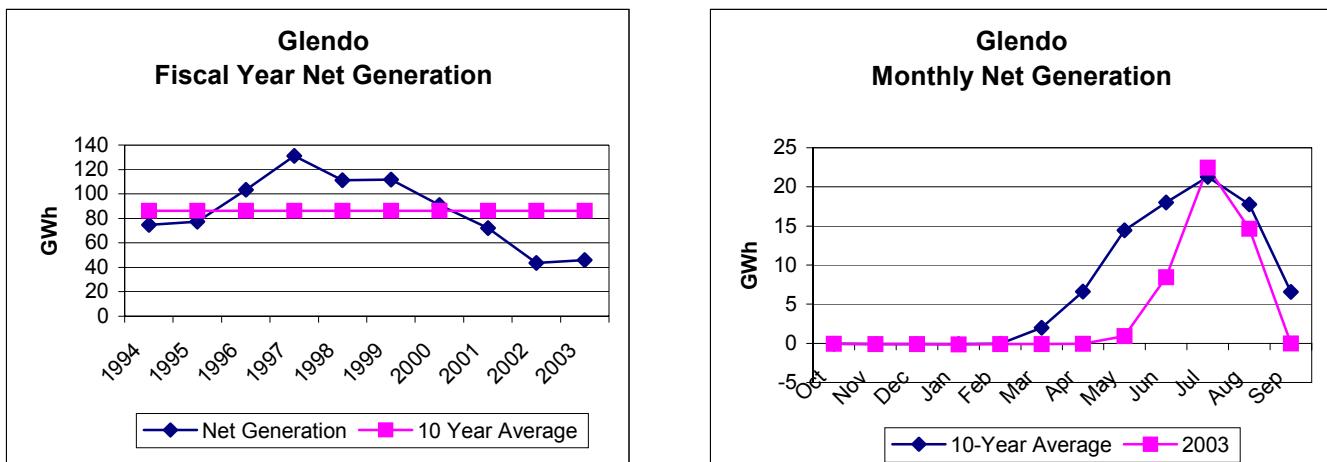


Prime Laboratory Benchmarks

**Benchmark 1
Wholesale Firm Rate**






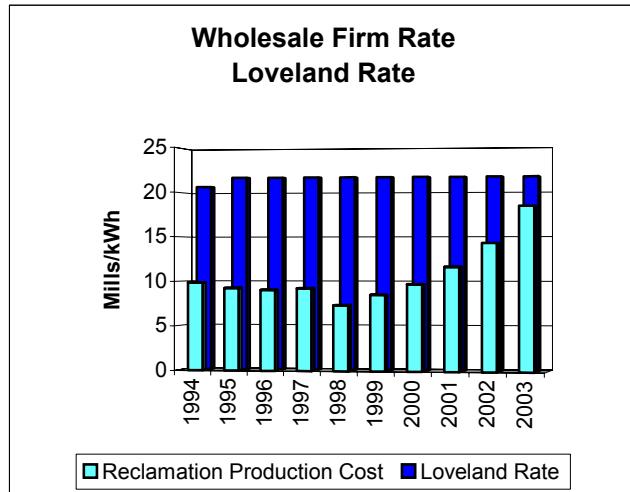


**Benchmark 2
Reclamation's Production Cost as Percentage of Wholesale Firm Rate**

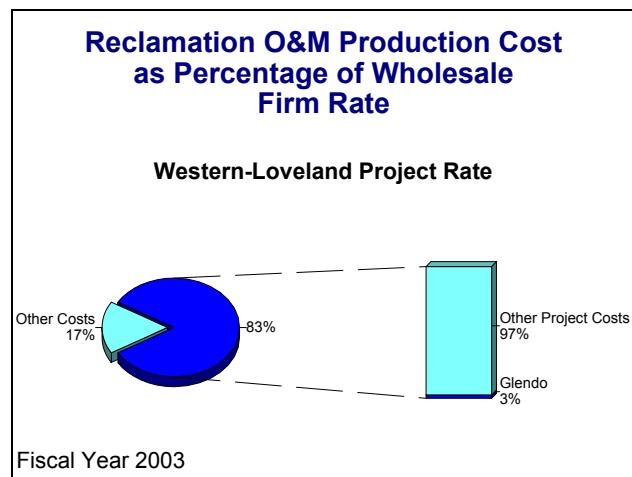

**Glendo Powerplant
Seasonal**





**Benchmark 3
Production Cost**

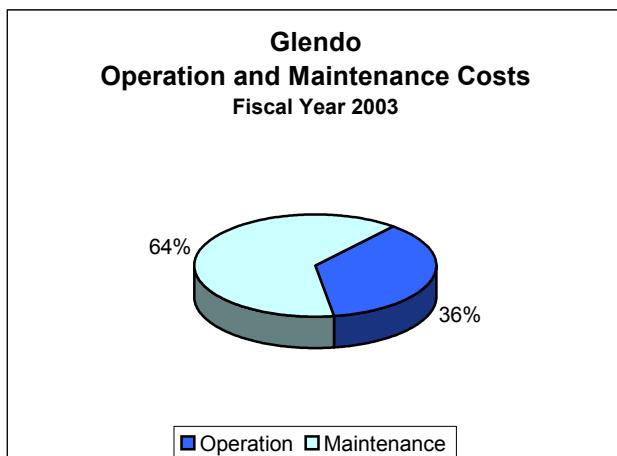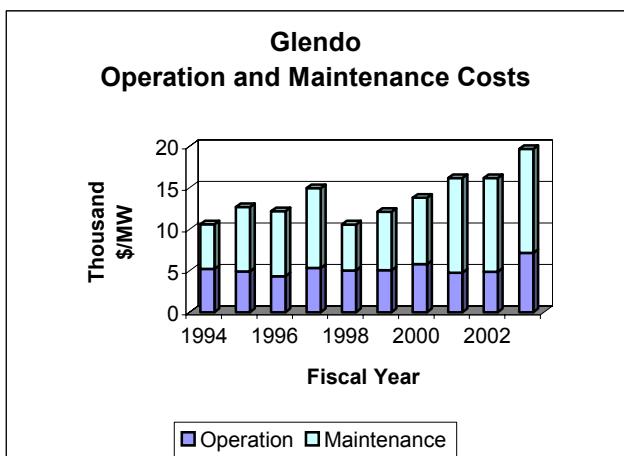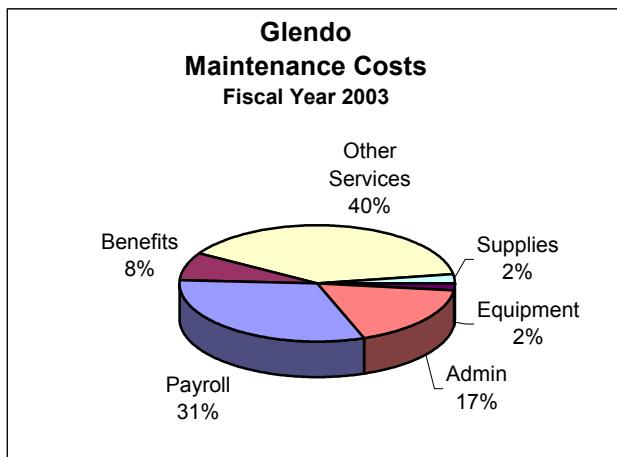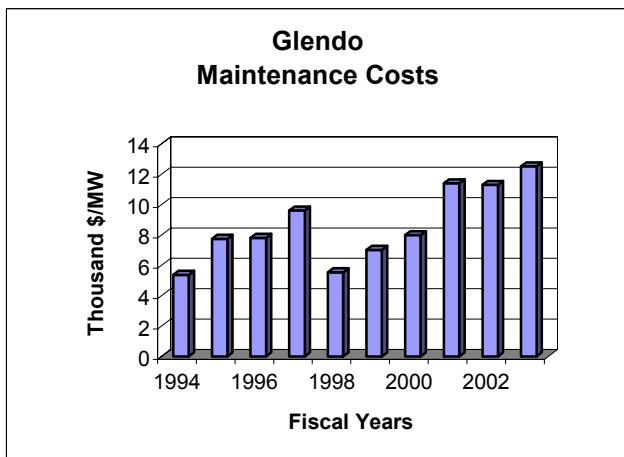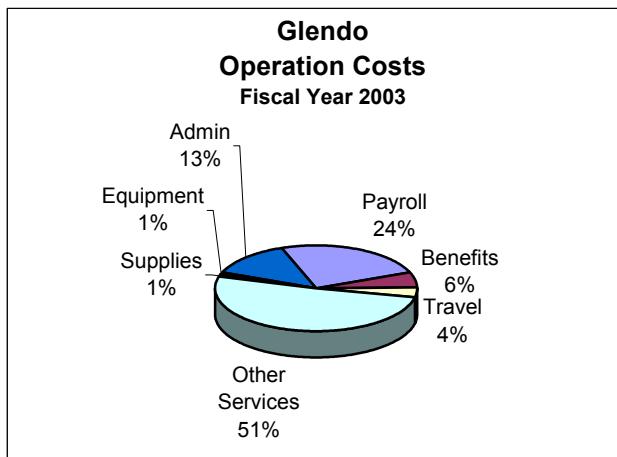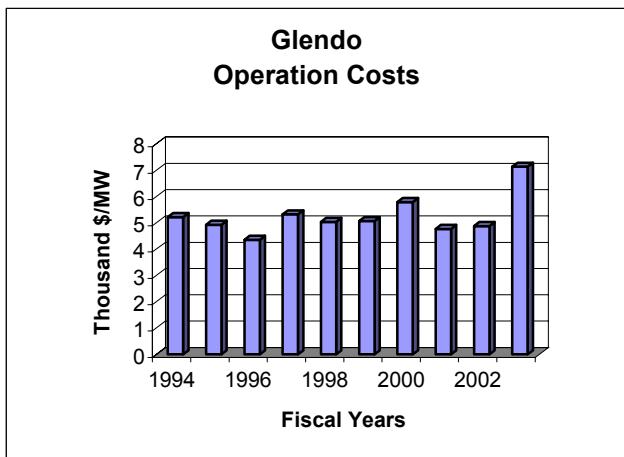

**Glendo Powerplant
Seasonal**

**Benchmark 4
Workforce Deployment**


Glendo 2003 Equivalent Work Year Levels						
	Equiv Work Year Charged to Powerplant	Leave Additive	Denver and Washington Equiv Work Year Additive	Total Equiv Work Year Allocated to Powerplant	Total Equiv Work year per Generating Unit	Total Equiv Work Year per Megawatt
General	1.58	0.17	0.04	1.8	0.9	0.047
Operation	1.38	0.15	0	1.52	0.76	0.04
Maintenance	2.34	0.25	0	2.59	1.3	0.068
Total Staffing	5.3	0.57	0.04	5.91	2.96	0.16

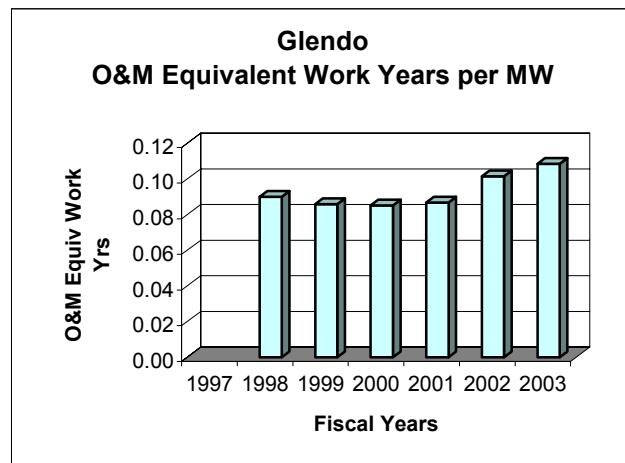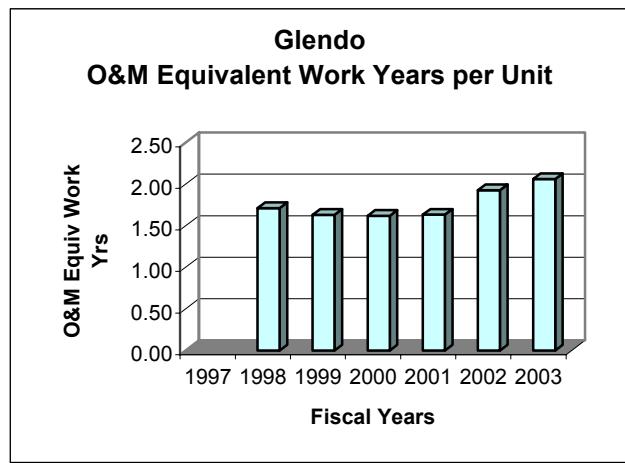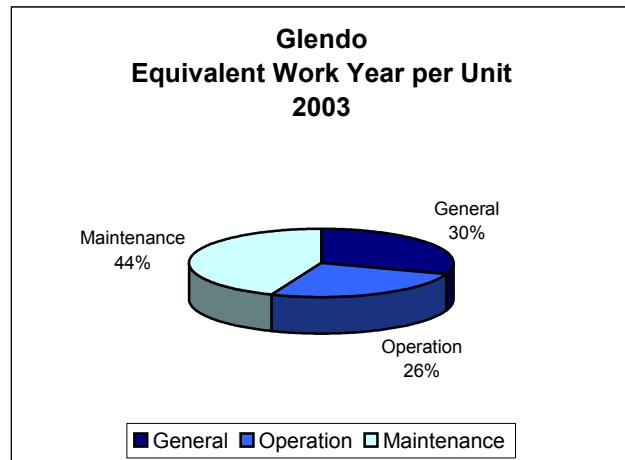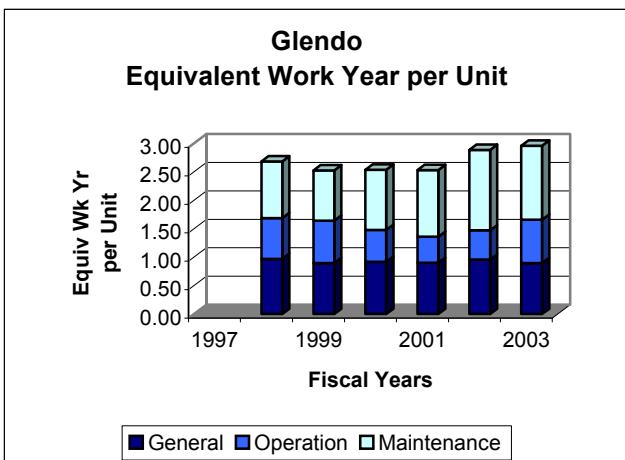


Distributive Accounts not available for FY-97

**Glendo Powerplant
Seasonal**

**Benchmark 5
Availability Factor**

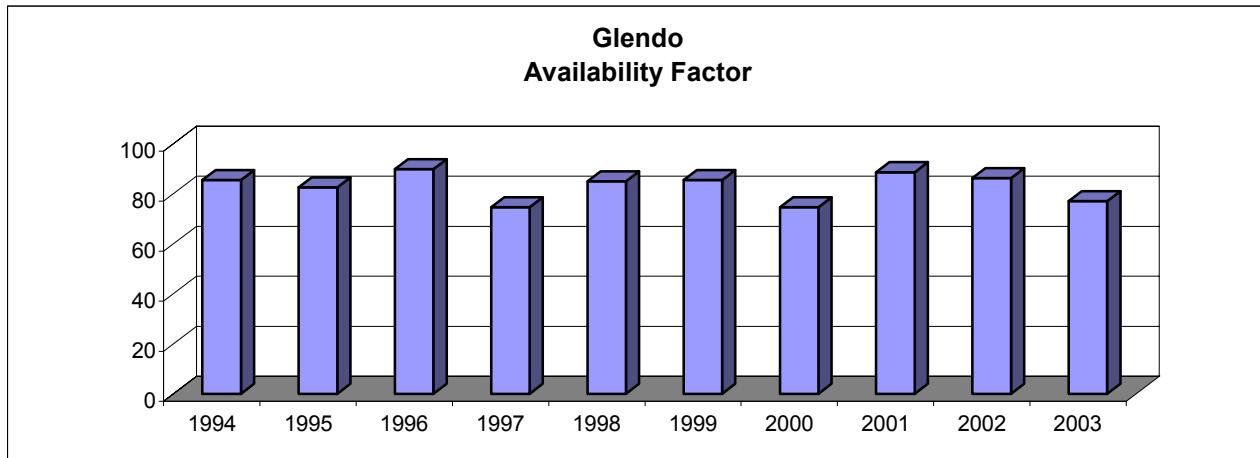


**Benchmark 6
Forced Outage Factor**

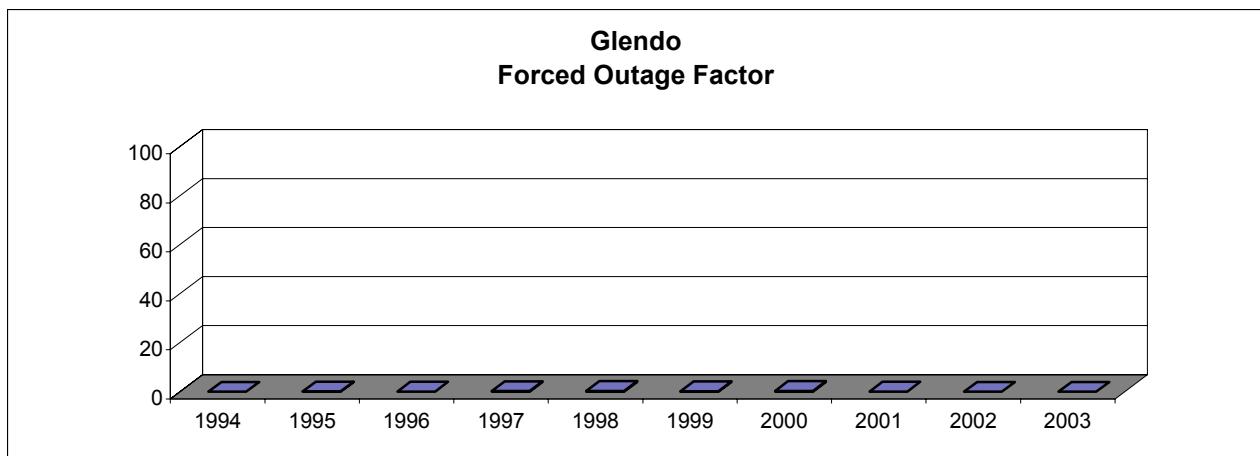


**Glendo Powerplant
Seasonal**

**Benchmark 7
Scheduled Outage Factor**

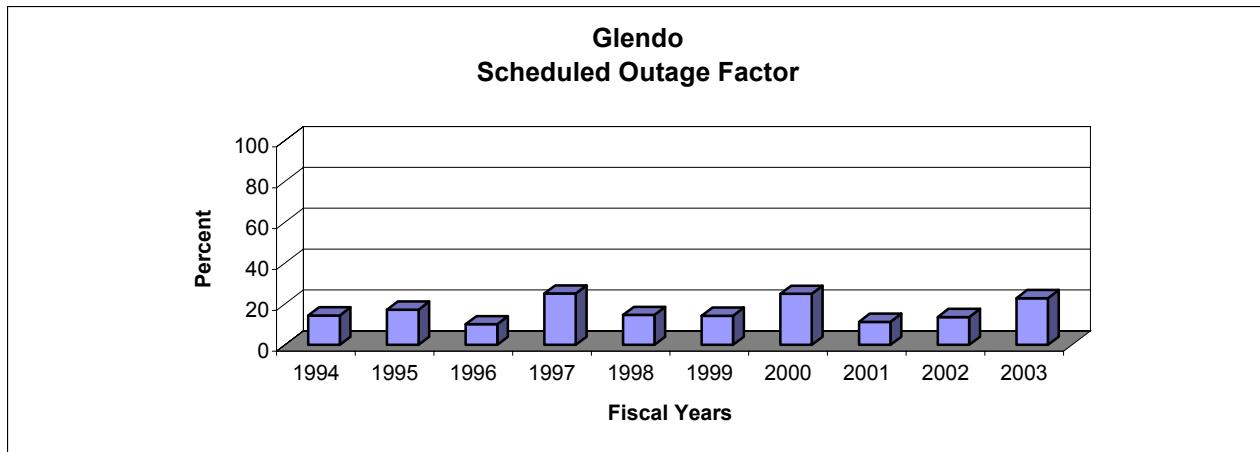

Extended maintenance done during winter shutdown
FY 03 – Unit 1 schedule outage extended for replacement of water service piping.

Starts

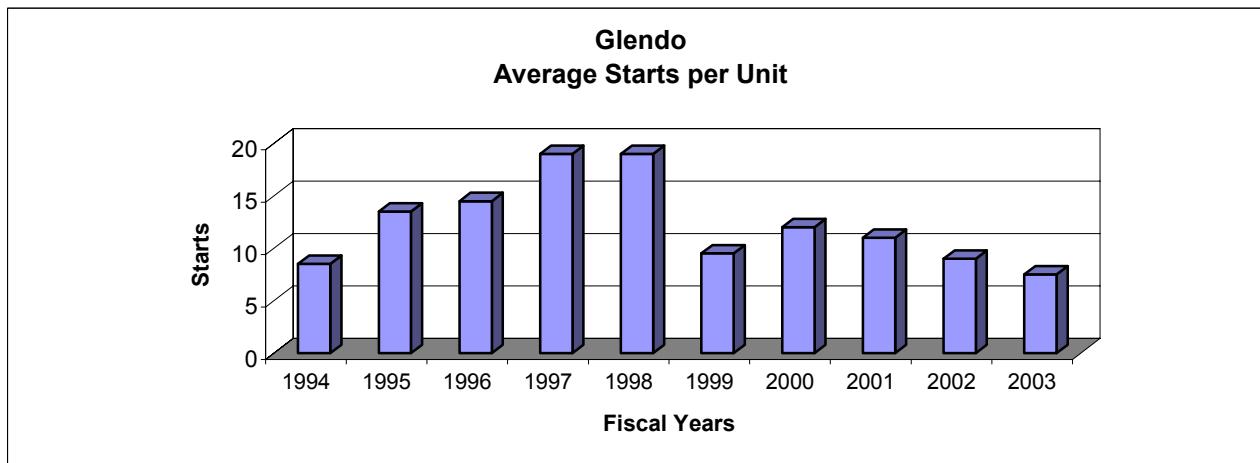

Benchmark Data Comparison

Fiscal Year 2003	Glendo	Total Reclamation Average	Industry Average	Best Performers
Wholesale Firm Rate Mills/kWh	21.7	*23.1	Not Available	Not Available
Production Cost as Percentage of Wholesale Firm Rate	2.18%	12.0%	Not Applicable	Not Applicable
O&M Cost \$/MWh	16.3	2.7	Not Applicable	1.1
O&M Costs \$/MW	19,657	7,315	Not Applicable	3,108
O&M Equiv Work Year per MW	0.1	0.04	Not Available	0.010
Availability Factor	77.0	83.6	**88.9	99.1
Forced Outage Factor	0.0	1.5	**2.4	0.0
Scheduled Outage Factor	23.0	14.9	**8.7	0.0

*Weighted by Net Generation

**2002 NERC Average